

**AAMA 1503-09 THERMAL PERFORMANCE
TEST REPORT**

Rendered to:

TUBELITE, INC.

SERIES/MODEL: CW3700 Casement Window

TYPE: Casement

Summary of Results	
Thermal Transmittance (U-Factor)	0.46
Condensation Resistance Factor - Frame (CRF _f)	59
Condensation Resistance Factor - Glass (CRF _g)	68
Unit Size	23-5/8" x 59" (600 mm x 1499 mm)
Layer 1	1/4" PPG Solarban 60 (e=0.035*, #2) Tempered
Gap 1	0.47" Gap, Technoform TGI Spacer (TS-D), 90% Argon-Filled*
Layer 2	1/4" Clear Tempered

Reference must be made to Report No. A4277.02-116-46, dated 10/29/10 for complete test specimen description and data.

AAMA 1503-09 THERMAL PERFORMANCE TEST REPORT

Rendered to:

TUBELITE, INC.
4878 Mackinaw Trail
Reed City, Michigan 49677

Report Number: A4277.02-116-46
Test Date: 10/19/10
Report Date: 10/29/10
Test Record Retention Date: 10/19/14

Test Sample Identification:

Series/Model: CW3700 Casement Window

Type: Casement

Test Sample Submitted by: Client

Test Procedure: The condensation resistance factor (CRF) and thermal transmittance (U) were determined in accordance with AAMA 1503-09, *Voluntary Test Method for Thermal Transmittance and Condensation Resistance of Windows, Doors and Glazed Wall Sections*

- | | |
|---|---------|
| 1. Average warm side ambient temperature | 69.80 F |
| 2. Average cold side ambient temperature | -0.39 F |
| 3. 15 mph dynamic wind applied to test specimen exterior. | |
| 4. 0.0" \pm 0.04" static pressure drop across specimen. | |

Test Results Summary:

- | | |
|---|------|
| 1. Condensation resistance factor - Frame (CRF _f) | 59 |
| Condensation resistance factor - Glass (CRF _g) | 68 |
| 2. Thermal transmittance due to conduction (U) | 0.46 |
| (U-factors expressed in Btu/hr·ft ² ·F) | |

Test Sample Description:

CONSTRUCTION	Frame	Vent
Size (in.) Non-Standard	23-5/8" x 59"	22-7/8" x 58-1/4"
Daylight Opening (in.)	N/A	17-7/8" x 53-1/8"
CORNERS	Coped	Mitered
Fasteners	Screws	Keys & Stakes
Sealant	Yes	Yes
MATERIAL	AT (0.22")	AT (0.24")
Color Exterior	Black	Black
Finish Exterior	Anodized	Anodized
Color Interior	Black	Black
Finish Interior	Anodized	Anodized
GLAZING METHOD	N/A	Interior

Glazing Information:

Layer 1	1/4" PPG Solarban 60 (e=0.035*, #2) Tempered
Gap 1	0.47" Gap, Technoform TGI Spacer (TS-D), 90% Argon-Filled*
Layer 2	1/4" Clear Tempered
Gas Fill Method	Single-Probe Method*
Desiccant	Yes

**Stated per Client/Manufacturer*

NA Non-Applicable

See Description Table Abbreviations

Test Sample Description: (Continued)

COMPONENTS			
	Type	Quantity	Location
WEATHERSTRIP			
	Flexible hollow bulb gasket	2 rows	Vent perimeter
	EPDM gasket	1 row	Interior glazing perimeter
HARDWARE			
	Multi-point lock assembly	1	Lock jamb/stile
	Multi-arm hinge	2	Head/top rail, sill/bottom rail
	Roto-operator	1	Sill/bottom rail
DRAINAGE			
	No visible weeps		

Test Duration:

1. The environmental systems were started at 07:47 hours, 10/18/10.
2. The thermal performance test results were derived from 02:09 hours, 10/19/10 to 06:09 hours, 10/19/10.

Condensation Resistance Factor (CRF):

The following information, condensed from the test data, was used to determine the condensation resistance factor:

T_h	=	Warm side ambient air temperature	69.80 F
T_c	=	Cold side ambient air temperature	-0.39 F
FT_p	=	Average of pre-specified frame temperatures (14)	41.46 F
FT_r	=	Average of roving thermocouples (4)	34.98 F
W	=	$[(FT_p - FT_r) / (FT_p - (T_c + 10))]$ x 0.40	0.081
FT	=	$FT_p(1-W) + W (FT_r)$ = Frame Temperature	40.93 F
GT	=	Glass Temperature	47.58 F
CRF_g	=	Condensation resistance factor – Glass	68
		$CRF_g = (GT - T_c) / (T_h - T_c) \times 100$	
CRF_f	=	Condensation resistance factor – Frame	59
		$CRF_f = (FT - T_c) / (T_h - T_c) \times 100$	

The CRF number was determined to be 59 (on the size as reported). When reviewing this test data, it should be noted that the frame temperature (FT) was colder than the glass temperature (GT) therefore controlling the CRF number. Refer to the 'CRF Report' page and the 'Thermocouple Location Diagram' page of this report.

Thermal Transmittance (U_c):

T_h	=	Average warm side ambient temperature	69.80 F
T_c	=	Average cold side ambient temperature	-0.39 F
P	=	Static pressure difference across test specimen	0.00 psf
		15 mph dynamic perpendicular wind at exterior	
Nominal sample area			9.68 ft ²
Total measured input to calorimeter			408.54 Btu/hr
Calorimeter correction			94.51 Btu/hr
Net specimen heat loss			314.03 Btu/hr
U	=	Thermal Transmittance	0.46 Btu/hr·ft ² ·F

Glazing Deflection (in.):

	Vent
Edge Gap Width	0.47
Estimated center gap width upon receipt of specimen in laboratory (after stabilization)	0.44
Center gap width at laboratory ambient conditions on day of testing	0.44
Center gap width at test conditions	0.41

The sample was inspected for the formation of frost or condensation, which may influence the surface temperature measurements. The sample showed no evidence of condensation/frost at the conclusion of the test.

A calibration of the Architectural Testing Inc. 'thermal test chamber' (ICN 000001) in York, Pennsylvania was conducted in May 2010 in accordance with Architectural Testing Inc. calibration procedure.

Prior to testing the specimen was sealed with silicone on the interior side and checked for air infiltration per Section 9.3.4.

CRF Report

Time: 04:09 04:39 05:09 05:39 06:09 AVERAGE

Pre-specified Thermocouples - Frame

1	34.82	34.85	34.82	34.83	34.82	34.83
2	35.52	35.53	35.51	35.69	35.65	35.58
3	41.62	41.61	41.61	41.60	41.61	41.61
4	42.16	42.20	42.18	42.17	42.22	42.19
5	43.79	43.79	43.80	43.83	43.77	43.80
6	43.69	43.69	43.67	43.72	43.69	43.69
7	40.47	40.55	40.42	40.49	40.55	40.49
8	39.77	39.72	39.71	39.74	39.76	39.74
9	40.28	40.27	40.29	40.29	40.29	40.28
10	39.05	39.03	39.02	39.02	39.07	39.04
11	37.14	37.14	37.15	37.20	36.79	37.08
12	69.07	69.07	69.21	69.23	68.96	69.11
13	36.89	36.89	37.00	37.00	36.85	36.93
14	36.07	36.06	36.07	36.09	36.07	36.07
FT _p	41.45	41.46	41.46	41.49	41.44	41.46

Pre-specified Thermocouples - Glass

15	34.38	34.27	34.40	34.42	34.39	34.37
16	56.49	56.53	56.55	56.58	56.54	56.54
17	45.42	45.42	45.39	45.43	45.43	45.42
18	46.77	46.78	46.80	46.81	46.78	46.79
19	58.35	58.42	58.44	58.44	58.45	58.42
20	43.92	43.96	43.92	43.93	43.96	43.94
GT	47.56	47.56	47.58	47.60	47.59	47.58

Cold Point (Roving) Thermocouples

21	34.80	34.80	34.80	34.80	34.80	34.80
22	34.90	34.90	34.90	34.90	34.90	34.90
23	34.90	34.90	34.90	34.90	34.90	34.90
24	35.30	35.30	35.30	35.30	35.30	35.30
FT _R	34.98	34.98	34.98	34.98	34.98	34.98
W	0.08	0.08	0.08	0.08	0.08	0.08
FT	40.93	40.93	40.93	40.96	40.91	40.93

Warm Side - Room Ambient Air Temperature


69.80	69.81	69.80	69.80	69.80	69.80	69.80
-------	-------	-------	-------	-------	-------	-------

Cold Side - Room Ambient Air Temperature





-0.41	-0.40	-0.42	-0.37	-0.41	-0.40
-------	-------	-------	-------	-------	-------

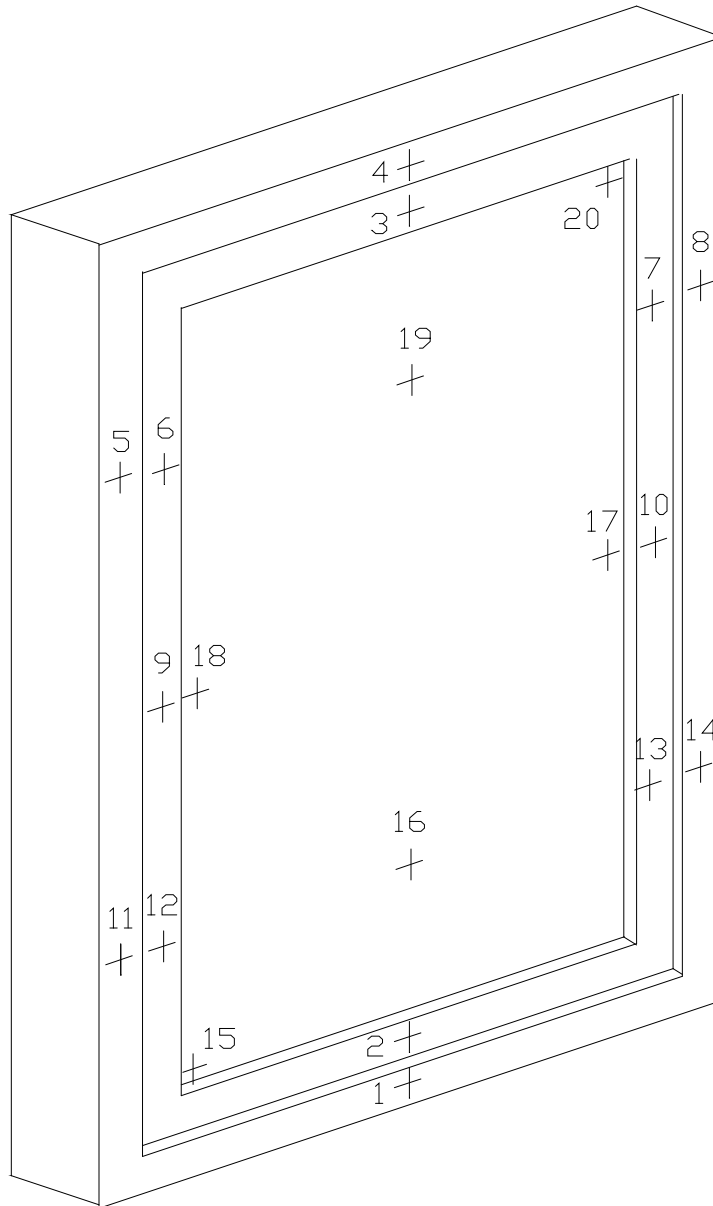CRF _f	59	59	59	59	59	59
CRF _g	68	68	68	68	68	68

Thermocouple Location Diagram



Cold Point Locations

	21. 34.80
	22. 34.90
	23. 34.90
	24. 35.30

Detailed drawings, data sheets, representative samples of test specimens, a copy of this report, or other pertinent project documentation will be retained by Architectural Testing, Inc. for a period of four years from the original test date. At the end of this retention period such materials shall be discarded without notice and the service life of this report by Architectural Testing will expire. Results obtained are tested values and were secured by using the designated test methods. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen(s) tested. This report may not be reproduced, except in full, without the written approval of Architectural Testing, Inc.

For ARCHITECTURAL TESTING, INC.

Ryan P. Moser
Technician

Shon W. Einsig
Senior Technician
Individual-In-Responsible-Charge

RPM:ake
A4277.02-116-46

Attachments (pages): This report is complete only when all attachments listed are included.

Appendix-A: Description Table Abbreviations (1)

Appendix-B: Drawings (8)

Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
.02R0	10/29/10	All	Original Report Issue. Work requested by Steve Wilkening of Tubelite, Inc.

Appendix A: Description Table Abbreviations

CODE	Frame / Sash Types
AI	Aluminum w/ Vinyl Inserts (Caps)
AL	Aluminum
AP	Aluminum w/ Thermal Breaks - Partial
AS	Aluminum w/ Steel Reinforcement
AT	Aluminum w/ Thermal Breaks - All Members ($> 0.21"$)
AU	Aluminum Thermally Improved - All Members ($0.062" - 0.209"$)
AV	Aluminum / Vinyl Composite
AW	Aluminum-clad Wood
FG	Fiberglass
PA	ABS Plastic w/ All Members Reinforced
PC	ABS Plastic-clad Aluminum
PF	ABS Plastic w/ Foam-filled Insulation
PH	ABS Plastic w/ Horizontal Members Reinforced
PI	ABS Plastic w/ Reinforcement - Interlock
PL	ABS Plastic
PP	ABS Plastic w/ Reinforcement - Partial
PV	ABS Plastic w/ Vertical Members Reinforced
PW	ABS Plastic-clad Wood
ST	Steel
VA	Vinyl w/ All Members Reinforced
VC	Vinyl-clad Aluminum
VF	Vinyl w/ Foam-filled Insulation
VH	Vinyl w/ Horizontal Members Reinforced
VI	Vinyl w/ Reinforcement - Interlock
VP	Vinyl w/ Reinforcement - Partial
VV	Vinyl w/ Vertical Members Reinforced
VW	Vinyl-clad Wood
VY	Vinyl
WA	Aluminum / Wood composite
WD	Wood
WV	Vinyl / Wood composite
WF	Fiberglass/Wood Combination
WC	Composite/Wood Composite (Shaped vinyl/wood composite members)
CW	Copper Clad Wood
CO	Vinyl/Wood Composite Material

CODE	Spacer Types (See sealant)
A1	Aluminum
A2	Aluminum (Thermally-broken)
A3	Aluminum-reinforced Polymer
A4	Aluminum / Wood
A5	Aluminum-reinforced Butyl (Swiggle)
A6	Aluminum / Foam / Aluminum
A7	Aluminum U-shaped
A8	Aluminum-Butyl (Corrugated) (Duraseal)
ER	EPDM Reinforced Butyl
FG	Fiberglass
GL	Glass
OF	Organic Foam
P1	Duralite
PU	Polyurethane Foam
SU	Stainless Steel, U-shaped
CU	Coated Steel, U-shaped (Intercept)
S2	Steel (Thermally-broken)
S3	Steel / Foam / Steel
S5	Steel-reinforced Butyl
S6	Steel U-channel w/ Thermal Cap
SS	Stainless Steel
CS	Coated Steel
TP	Thermo-plastic
WD	Wood
ZE	Elastomeric Silicone Foam
ZF	Silicone Foam
ZS	Silicone / Steel
N	Not Applicable
TS	Thermo-plastic w/ stainless steel substrate

CODE	Tint Codes
AZ	Azurlite
BL	Blue
BZ	Bronze
CL	Clear
EV	Evergreen
GD	Gold
GR	Green
GY	Gray
LE	Low 'e' Coating
OT	Other (use comment field)
RC	Solar or Reflective Coating
RG	Roller Shades between glazing
RS	Silver (reflective coating)
SF	Suspended Polyester Film
SR	Silver
BG	Blinds between the Glazing
DV	Dynamic Glazing-Variable
DY	Dynamic Glazing-NonVariable

CODE	Gap Fill Codes
AIR	Air
AR2	Argon/Krypton Mixture
AR3	Argon / Krypton / Air
ARG	Argon/Air
CO2	Carbon Dioxide
KRY	Krypton/Air
SF6	Sulfur Hexafluoride
XE2	Xenon/Krypton/Air
XE3	Xenon/Argon/Air
XEN	Xenon/Air
N	Not Applicable

DOOR DETAILS	
N	Not Applicable
CODE	Door Type
EM	Embossed
FL	Flush
LF	Full Lite
LH	1/2 - Lite
LQ	1/4 - Lite
LT	3/4 - Lite
RP	Raised Panel
CODE	Skin
AL	Aluminum
FG	Fiberglass
GS	Galvanized Steel
ST	Steel
WD	Wood
VY	Vinyl
CODE	Panel
FG	Fiberglass
PL	Plastic
WP	Wood - Plywood
WS	Wood - Solid
CODE	Sub-Structure
GS	Galvanized Steel
ST	Steel
WD	Wood
VY	Vinyl
CODE	Core Fill
CH	Cellular - Honeycomb
EP	Expanded Polystyrene
PI	Polyisocyanurate
PU	Polyurethane
WP	Wood - Plywood
WS	Wood - Solid
XP	Extruded Polystyrene

CODE	Spacer Sealant
D	Dual Seal Spacer System
S	Single Seal Spacer System

CODE	Grid Description
N	No Muntins
G	Grids between glass
S	Simulated Divided Lites
T	True Muntins

CODE	Grid Size Codes
	Blank for no grids
0.75	Grids $< 1"$
1.5	Grids $\geq 1"$

CODE	Thermal Breaks
F	Foam
U	Urethane
V	Vinyl
FB	Fiberglass
O	Other
AB	ABS
NE	Neoprene
AI	Air
N	Not Applicable
P	Polyamide

Appendix B: Drawings


T959-1



Architectural Testing

Test sample complies with these details.
Deviations are noted.

Report# A4277
Date 10/19/10 Tech RPM

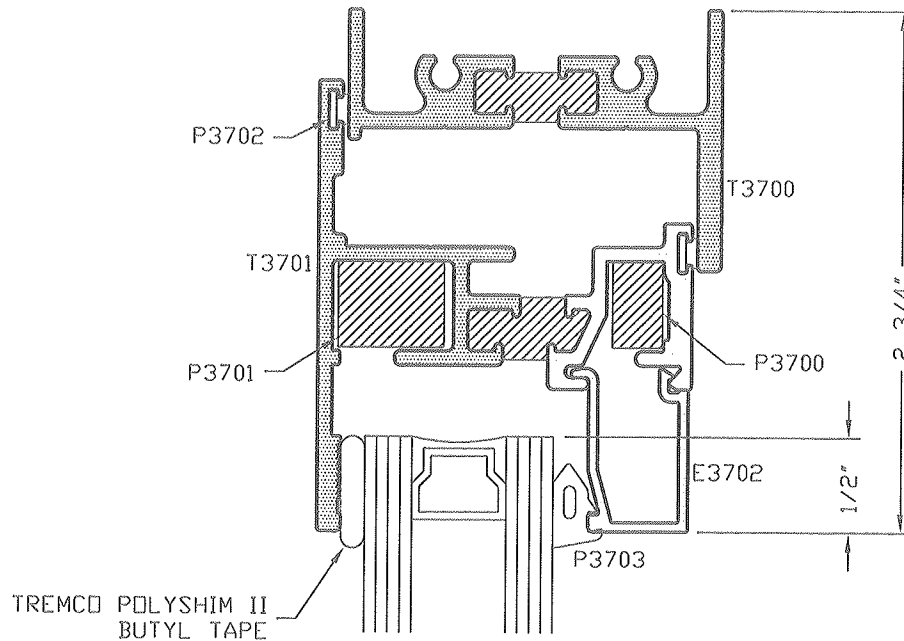

TUBELITE®
STOREFRONT, CURTAINWALL & ENTRANCES
DEPENDABLE

CW3700 CASEMENT WINDOW
THERMAL PERFORMANCE TEST
HEAD DETAIL


DRAWN BY JEM	DRWG DATE 10/06/10	APPV'D BY	DATE APPV'D
DRWG SCALE 1"=1"	PRODUCT CODE 120	T959-1	REV



Architectural Testing

Test sample complies with these details.
Deviations are noted.

Report# A4277
Date 10/19/10 Tech Rpm

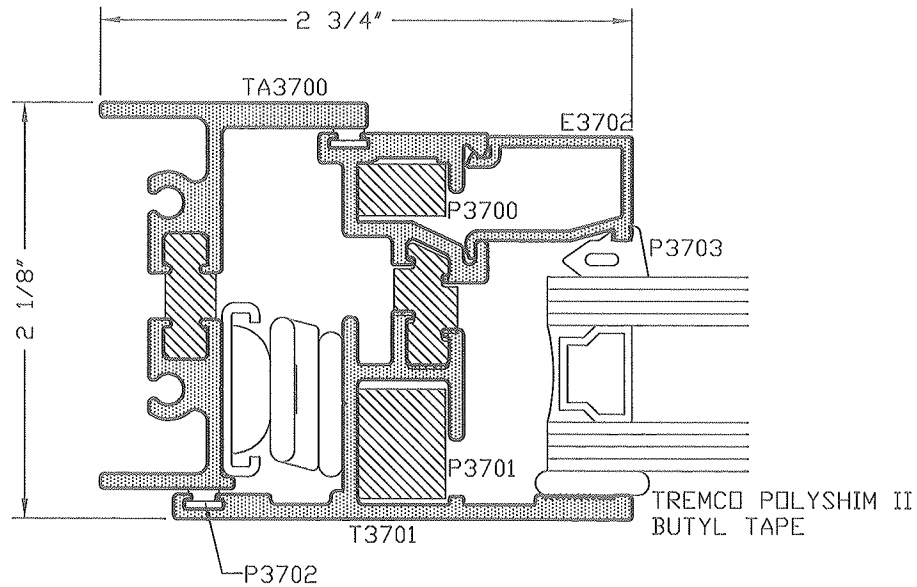

TUBELITE®
STOREFRONT, CURTAINWALL & ENTRANCES
DEPENDABLE

CW3700 CASEMENT WINDOW THERMAL PERFORMANCE TEST JAMB DETAIL


DRAWN BY JEM	DRWG DATE 10/06/10	APPV'D BY	DATE APPV'D	REV
DRWG SCALE 1"=1"	PRODUCT CODE 120	T959-2		



Architectural Testing

Test sample complies with these details.
Deviations are noted.

Report# A4277
Date 10/19/10 Tech RFM

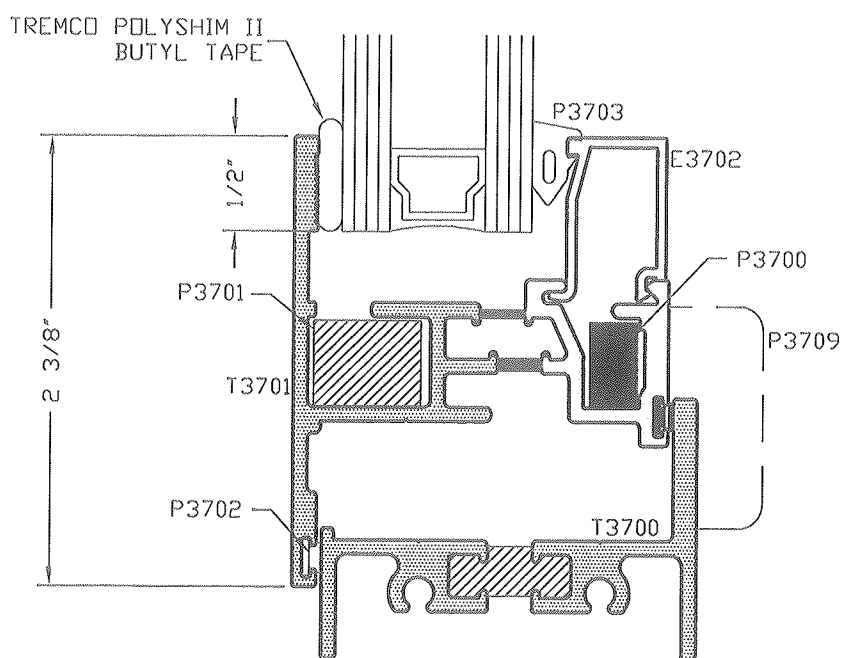



TUBELITE®
STOREFRONT, CURTAINWALL & ENTRANCES
DEPENDABLE

CW3700 CASEMENT WINDOW THERMAL PERFORMANCE TEST SILL DETAIL

DRAWN BY JEM	DRWG DATE 10/06/10	APPV'D BY	DATE APPV'D
DRWG SCALE 1"=1"	PRODUCT CODE 120	T959-3	REV


Test sample complies with these details.
Deviation: are noted.

Report# 194711
Date 10/12/10 Tech Rjm

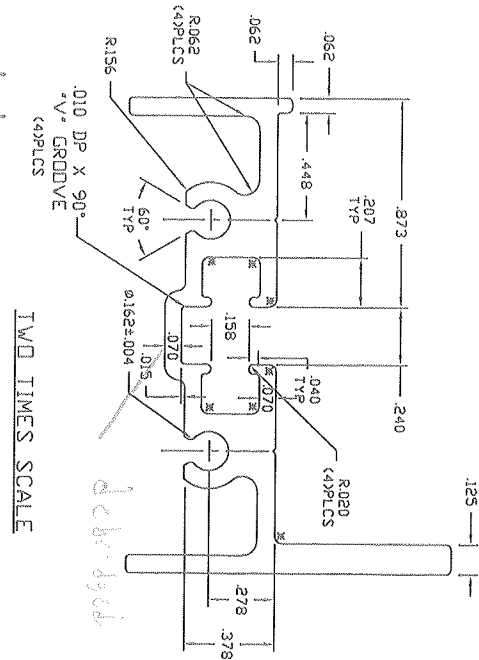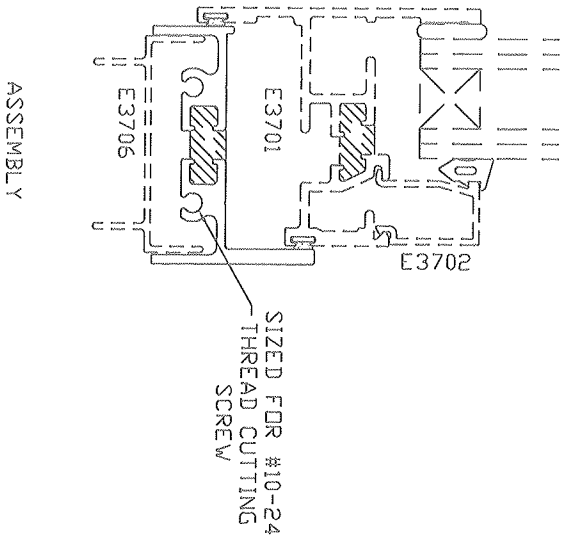

TWO TIMES SCALE

2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139
140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179
180
181
182
183
184
185
186
187
188
189
190
191
192
193
194
195
196
197
198
199
200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360
361
362
363
364
365
366
367
368
369
370
371
372
373
374
375
376
377
378
379
380
381
382
383
384
385
386
387
388
389
390
391
392
393
394
395
396
397
398
399
400
401
402
403
404
405
406
407
408
409
410
411
412
413
414
415
416
417
418
419
420
421
422
423
424
425
426
427
428
429
430
431
432
433
434
435
436
437
438
439
440
441
442
443
444
445
446
447
448
449
450
451
452
453
454
455
456
457
458
459
460
461
462
463
464
465
466
467
468
469
470
471
472
473
474
475
476
477
478
479
480
481
482
483
484
485
486
487
488
489
490
491
492
493
494
495
496
497
498
499
500
501
502
503
504
505
506
507
508
509
510
511
512
513
514
515
516
517
518
519
520
521
522
523
524
525
526
527
528
529
530
531
532
533
534
535
536
537
538
539
540
541
542
543
544
545
546
547
548
549
550
551
552
553
554
555
556
557
558
559
560
561
562
563
564
565
566
567
568
569
570
571
572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603
604
605
606
607
608
609
610
611
612
613
614
615
616
617
618
619
620
621
622
623
624
625
626
627
628
629
630
631
632
633
634
635
636
637
638
639
640
641
642
643
644
645
646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704
705
706
707
708
709
710
711
712
713
714
715
716
717
718
719
720
721
722
723
724
725
726
727
728
729
730
731
732
733
734
735
736
737
738
739
740
741
742
743
744
745
746
747
748
749
750
751
752
753
754
755
756
757
758
759
760
761
762
763
764
765
766
767
768
769
770
771
772
773
774
775
776
777
778
779
780
781
782
783
784
785
786
787
788
789
790
791
792
793
794
795
796
797
798
799
800
801
802
803
804
805
806
807
808
809
810
811
812
813
814
815
816
817
818
819
820
821
822
823
824
825
826
827
828
829
830
831
832
833
834
835
836
837
838
839
840
841

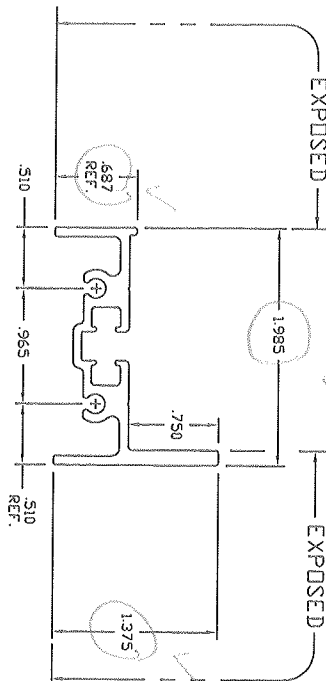

FULL SIZE

REV	DATE	DESCRIPTION	INIT
002/29/00	RECEIVED FOR TOOLING	CH	
001/17/00	PAINT NAME WAS CHANGED	CH	
001/17/00	PAINT NAME WAS CHANGED	SD	
A	000/00/00	RECEIVED FOR CAVITY FOR ADHESIVE	CH
000/00/00	RECEIVED FOR TOOLING	CH	

VAL	075	SECTION	S	WALT	6063-T5	RATIO	1111
REL		CLASS		AREA	504	WGFT	592
DEPTH	11054						
FACTOR	20	CURC	2.415	INITIAL		VALUE	1582
		SIZE					
RXX	672	SXX	197	LXX	228	CXX	826
RYT	284	SYT	048	LYT	041	CTY	528

CONVENTIONAL VENT FRAME 1 3/8" X 2"


VENT WINDOW

BLANK CRH	DATE	TIME	BY	DATE	TIME	BY
	08/23/00					
PAID	NOTED	PRODUCER'S CODE	120	E3700		A

AZODBRAD® AND FULLY DEBRIDGE

V	E3700
---	-------

E3702

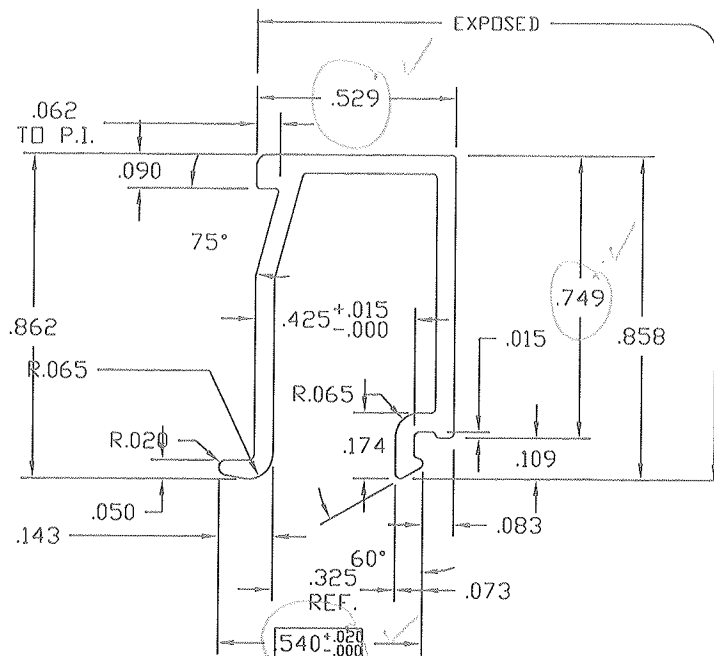


TWO TIMES SCALE




Architectural Testing

Test sample complies with these details.
Deviations are noted.

Report# 14577
Date 10/19/10 Tech RPM



FULL SCALE

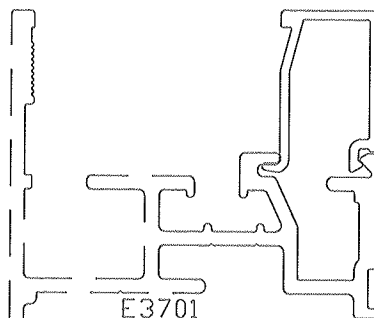

FULL SCALE ASSEMBLY

MATES WITH E3701

© 2006 TUBELITE INC. ALL RIGHTS RESERVED

ALUMINUM ASSOCIATION STANDARD
TOLERANCES APPLY UNLESS NOTED

ALL UNSPECIFIED RADII .015

* INDICATES .031 RADIUS

☐ DENOTES CRITICAL DIMENSION

ALL DIES PROPERTY OF TUBELITE

TUBELITE®
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

3056 WALKER RIDGE NW, SUITE G
WALKER, MICHIGAN 49544

REV	DATE	DESCRIPTION	INTL
	08/25/00	RELEASE FOR TOOLING	CRH
	09/15/00	PART NUMBER WAS E9080001	CRH
	02/13/02	PART NUMBER WAS E908A01	SRD


VALL THK.	.050	SECTION CLASS	S	MAT'L	6063-T5	RATIO	464:1
PERIMETER OUT (TOTAL)	4.737	AREA	.119	WGT/FT	.140		
FACTOR	34	CIRCLE SIZE	1.043	INFILL VOLUME	N/A		

RXX	.215	SXX	.020	IXX	.006	CXX	.351
RYY	.286	SYX	.026	IYY	.010	CYY	.490

GLASS STOP FOR 1" GLASS
VENT WINDOWS

DRAWN BY	CRH	DRWG DATE	08/17/00	APPV'D BY		DATE APPV'D	
DWG SCALE	NOTED	PRODUCT CODE	120	E3702		REV	

DRAWN BY	CRH	REV	DATE	08/17/00	APPROV'D BY	DATE	APPROV'D
DWG SCALE	NOTED	PRODUCT CODE	120	E3701			



Technoform Informational Bulletin



Architectural Testing

Test sample complies with these details.
Deviations are noted.

Master Part Chart List

Information Bulletin: 20060102PARTIB

Dated: 09/25/2007

Description: The current Technoform product line is listed in the following document. The products available include a nylon fixed corner key, a steel straight connector, a folding locking corner key and the Box and Wave I-SPACER™ (based on size). Additionally, in this document you will find the methodology for generating the part numbers to be used when ordering any of the products in our inventory.

Spacer Type	Spacer Width			Part Number			
	Fraction	Millimeters	Inches	Spacer	90° Keys	Folding Locking Key	Steel Connector
Box	7/32	5.56	0.2189	IS0732	CK0732F	NA	NA
Box	1/4	6.25	0.2461	IS0104	CK0104F	NA	SC0104S
Box	17/64	6.65	0.2618	IS1764	CK1764F	CK1764(1)	NA
Box	9/32	7.14	0.2811	IS0932	CK0932F	CK0932(1)	NA
Box	5/16	7.84	0.3087	IS0516	CK0516F	NA	SC0516S
Box	21/64	8.33	0.3300	IS2164	CK2164F	CK2164LK(1)	NA
Box	3/8	9.43	0.3713	IS0308	CK0308F	NA	SC0308S
Wave	13/32	10.22	0.4024	IS1332	CK1332F	CK1332LK	SC1332
Wave	7/16	11.01	0.4335	IS0716	CK0716F	NA	SC0716S
Wave	15/32	11.91	0.4689	IS1532	CK1532F	CK1532LK	SC1532S
Wave	1/2	12.60	0.4961	IS0102	CK0102F	NA	SC0102S
Wave	17/32	13.49	0.5272	IS1732	CK1732F	CK1732LK	SC1732S
Wave	9/16	14.19	0.5587	IS0916	CK0916F	NA	SC0916S
Wave	19/32	15.08	0.5937	IS1932	CK1932F	CL1932LK	SC1932S
Wave	5/8	15.87	0.6248	IS0508	CK0508F	NA	SC0508S
Wave	16/25	16.16	0.6362	IS1625	CK1625F	NA	SC1625S
Wave	21/32	16.67	0.6563	IS2132	CK2132F	CK2132LK	SC2132S
Wave	17/25	17.17	0.6760	IS1725	CK1725F	NA	SC1725S
Wave	23/32	18.26	0.7189	IS2332	CK2332F	CK2332LK	SC2332S
Wave	3/4	18.95	0.7461	IS0304	CK0304F	NA	SC0304S
Wave	25/32	19.74	0.7772	IS2532	CK2532F	CK2532LK	SC2532S

Nomenclature Rules: The following outlines the structure used to create part numbers.

Part Build → **Product** + **Size** + **Type** + **Color** = **Product ID**

Examples:

I-Spacer

IS

1532

F

LG

IS1532LG

Corner Key

CK

1532

F

CK1532F

Abbreviations:

IS I-Spacer

LG Light Gray

F

Fixed

S Steel

CK Corner Key

B Black

LK

Folding Locking


P Plastic

SC Straight Connector

W White

BR Bronze

Spacer width is the actual width as measured across the top of the thermoplastic blend.



Technoform North America
1755 Enterprise Parkway, Suite 300
Helpline: 330.487.6600
www.technoform.us

TECHNOFORM

GIVE YOUR WINDOWS SPECIAL POWERS™