

Test Report Summary
1350PI UniVent
 Acoustical Test: STC-OITC



TEST RESULTS

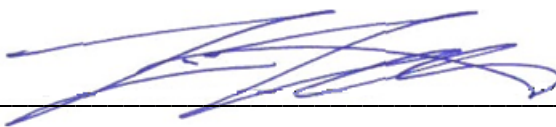
GLASS MAKEUP	STC	OITC
1" IGU: 1/4" Clear Tempered Exterior, 1/2" Air Space, 1/4" Clear Tempered	31	25
Unit Size: 59" x 23-5/8"		

TEST LAB

**Riverbank Acoustical
 Laboratories (RAL)**
 Geneva IL 60134

	1" IGU
Report Number	TL23-352
Test Date	10/20/2023
Report Date	10/20/2023

Reference above report for complete test specimen description and data.

Tubelite Representative:  (sign) 10/20/2023 (date)

Tim Fookes - Vice President Engineering Tubelite Alumicor

TEST METHODS

ASTM E90-09: Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements.

ASTM E413-16: Classification for Rating Sound Insulation

ASTM E1332-16: Standard Classification for Rating Outdoor-Indoor Sound Attenuation.